
eco-ATWB 10-3J12-Z

UNIT

STEEL SUPPORT CONFIGURATION

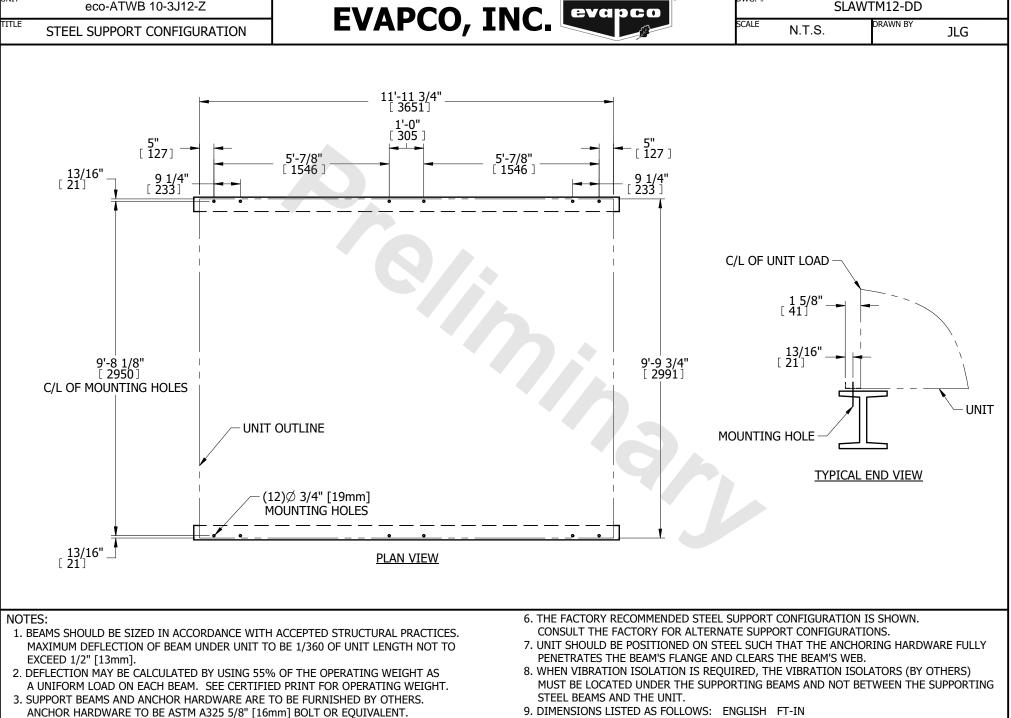

4. BEAMS MUST BE LOCATED UNDER THE FULL LENGTH OF THE PAN SECTION.

- 5. SUPPORTING BEAM SURFACE MUST BE LEVEL. DO NOT LEVEL THE UNIT BY
- PLACING SHIMS BETWEEN THE UNIT MOUNTING FLANGE AND THE SUPPORTING BEAM.

[METRIC] [mm]

DWG. #

SLAWTM12-DD